


LSI Design Selector - Softball/Baseball

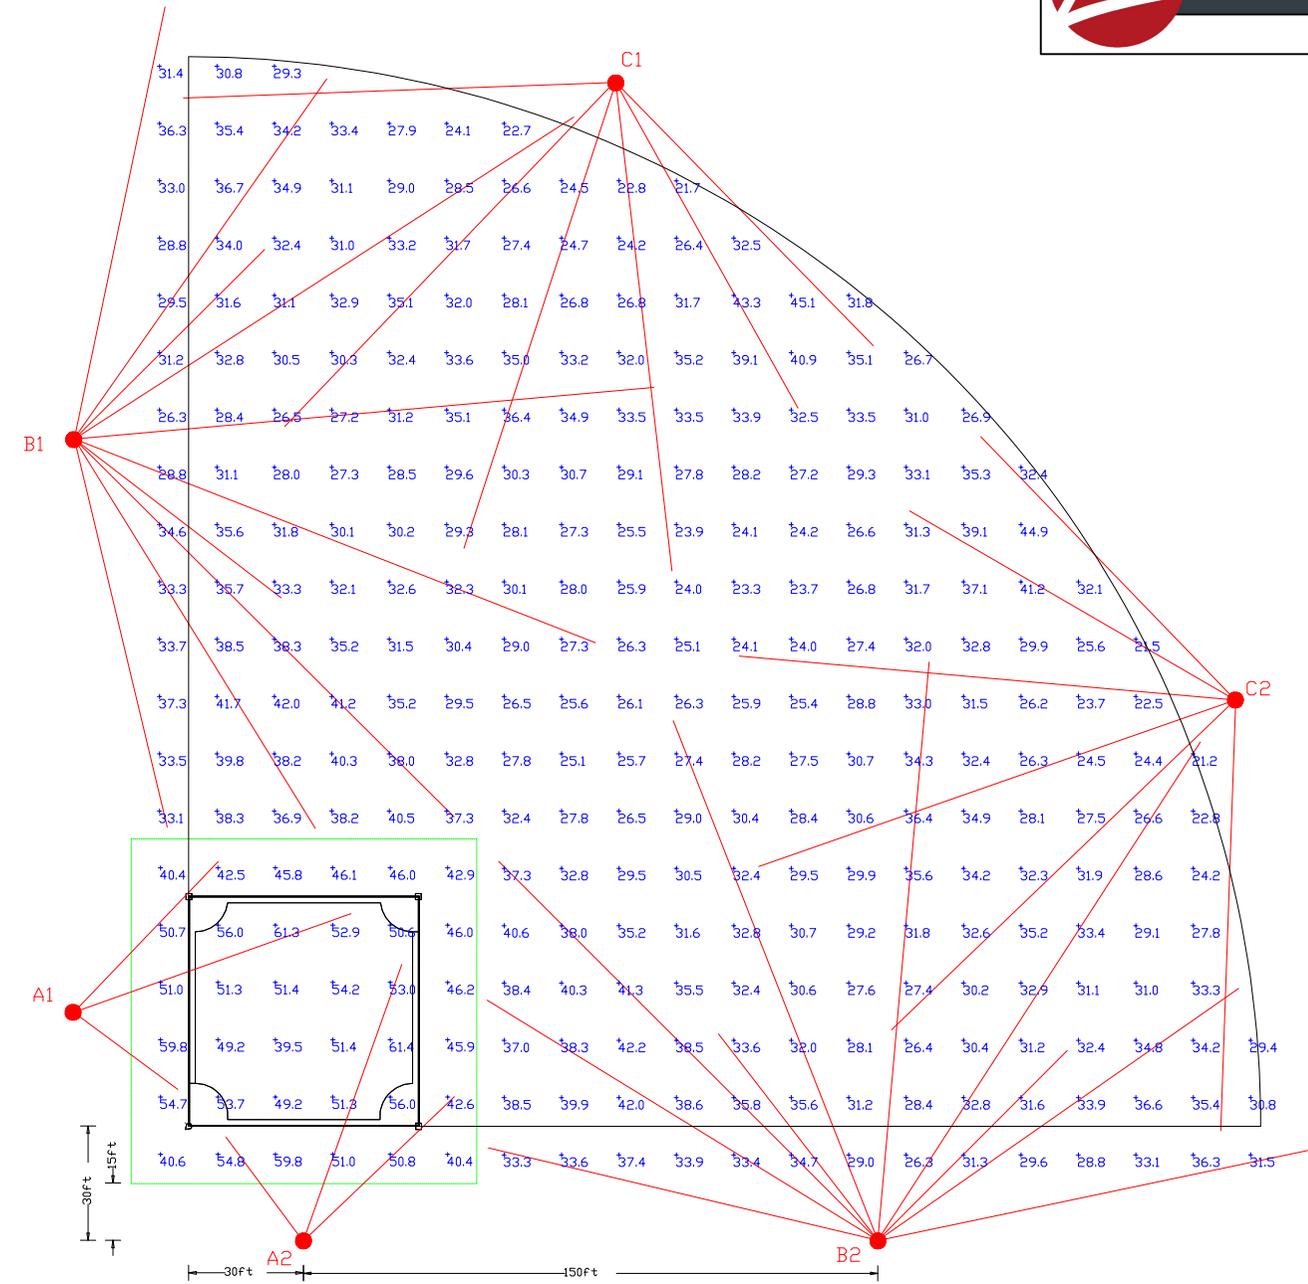

Softball/Baseball - 60' BASELINES
 280' HOME PLATE TO CENTER FIELD
 6 POLES
 Class 3: 50FC-INFIELD 30FC-OUTFIELD

POLE#	#POLES	Pole Height	Fixture	Qty/Pole	Total Fixtures	Watts/Fixture	Total Watts	Total KW	
A1	1	50'	ZNF-110L-MF-50-GS	1	1	783	783	0.78	
			ZNF-110L-MWF-50-GS	2	2	783	1,566	1.57	
							2,349	2.35	
A2	1	50'	ZNF-110L-MF-50-GS	1	1	783	783	0.78	
			ZNF-110L-MWF-50-GS	2	2	783	1,566	1.57	
							2,349	2.35	
B1	1	60'	ZNF-110L-NF-50-GS	5	5	732	3,660	3.66	
			ZNF-110L-MF-50-GS	3	3	783	2,349	2.35	
			ZNF-110L-MWF-50-GS	2	2	783	1,566	1.57	
							7,575	7.58	
B2	1	60'	ZNF-110L-NF-50-GS	5	5	732	3,660	3.66	
			ZNF-110L-MF-50-GS	3	3	783	2,349	2.35	
			ZNF-110L-MWF-50-GS	2	2	783	1,566	1.57	
							7,575	7.58	
C1	1	60'	ZNF-110L-MF-50-GS	6	6	783	4,698	4.70	
C2	1	60'	ZNF-110L-MF-50-GS	6	6	783	4,698	4.70	
TOTALS							38	29,244	29.24

Final Aiming Diagram, Racking Diagram, and Calculations Furnished upon Receipt of a released order.
 © 2022 LSI Industries Inc.
 10000 Alliance Road • Cincinnati, OH 45242 USA • www.lsi.com
 (513) 793-2200

**PHOTOMETRIC EVALUATION
 NOT FOR CONSTRUCTION**

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine the applicability of the layout to existing or future field conditions.

This lighting plan represents illumination levels calculated from laboratory data taken under controlled conditions in accordance with the Illuminating Engineering Society (IES) approved methods. Actual performance of any manufacturer's luminaires may vary due to changes in electrical voltage, tolerance in lamps/LED's and other variable field conditions. Calculations do not include obstructions such as buildings, curbs, landscaping, or any other architectural elements unless noted. Fixture nomenclature noted does not include mounting hardware or poles. This drawing is for photometric evaluation purposes only and should not be used as a construction document or as a final document for ordering product.

The IES no longer uses the Cutoff Classification System for LED fixtures. The IES classifies LED fixtures with the BUG rating which refers to the Backlight-Uplight-Glare system. An Uplight of "U0" most closely matches the old Full Cutoff rating.

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Grid Z
INFIELD	Illuminance	Fc	50	61.4	39.5	1.3	1.6	3
OUTFIELD	Illuminance	Fc	31	45.1	21.2	1.5	2.1	3

Symbol	Qty	Label	Arrangement	Description	LLF	Arr. Lum. Lumens	Arr. Watts
→	10	A33	SINGLE	ZNF-110L-NF-50-GS	0.930	99770	732
→	20	A44	SINGLE	ZNF-110L-MF-50-GS	0.930	107073	783
→	8	A55	SINGLE	ZNF-110L-MWF-50-GS	0.930	102030	783

Maintained Illumination Levels at 3' Above Grade.
 Final Aiming Diagram, Racking Diagram, and Calculations Furnished upon Receipt of a released order.

Dimensions of drawings that have been scaled or converted from PDF files or scanned /submitted images are approximate.

Total Project Watts
 Total Watts = 29244

10000 ALLIANCE RD. CINCINNATI, OH 45242 USA
 (513) 793-2200 • FAX (513) 793-6262

LIGHTING PROPOSAL **LD-163193**

SB_BB-60BL-2800F-6P-5060H-CL3_5030avg

BY/THC	DATE	REV	SHEET 1 OF 1
SCALE: 1"=50' ARCH B		0	50