



# Typical Parking Garage Section


Fixture Spacing: 20' x 30'

Fixture Height: 12'

Reflectances: 35% Ceiling 35% Walls 20% Floor



CPG

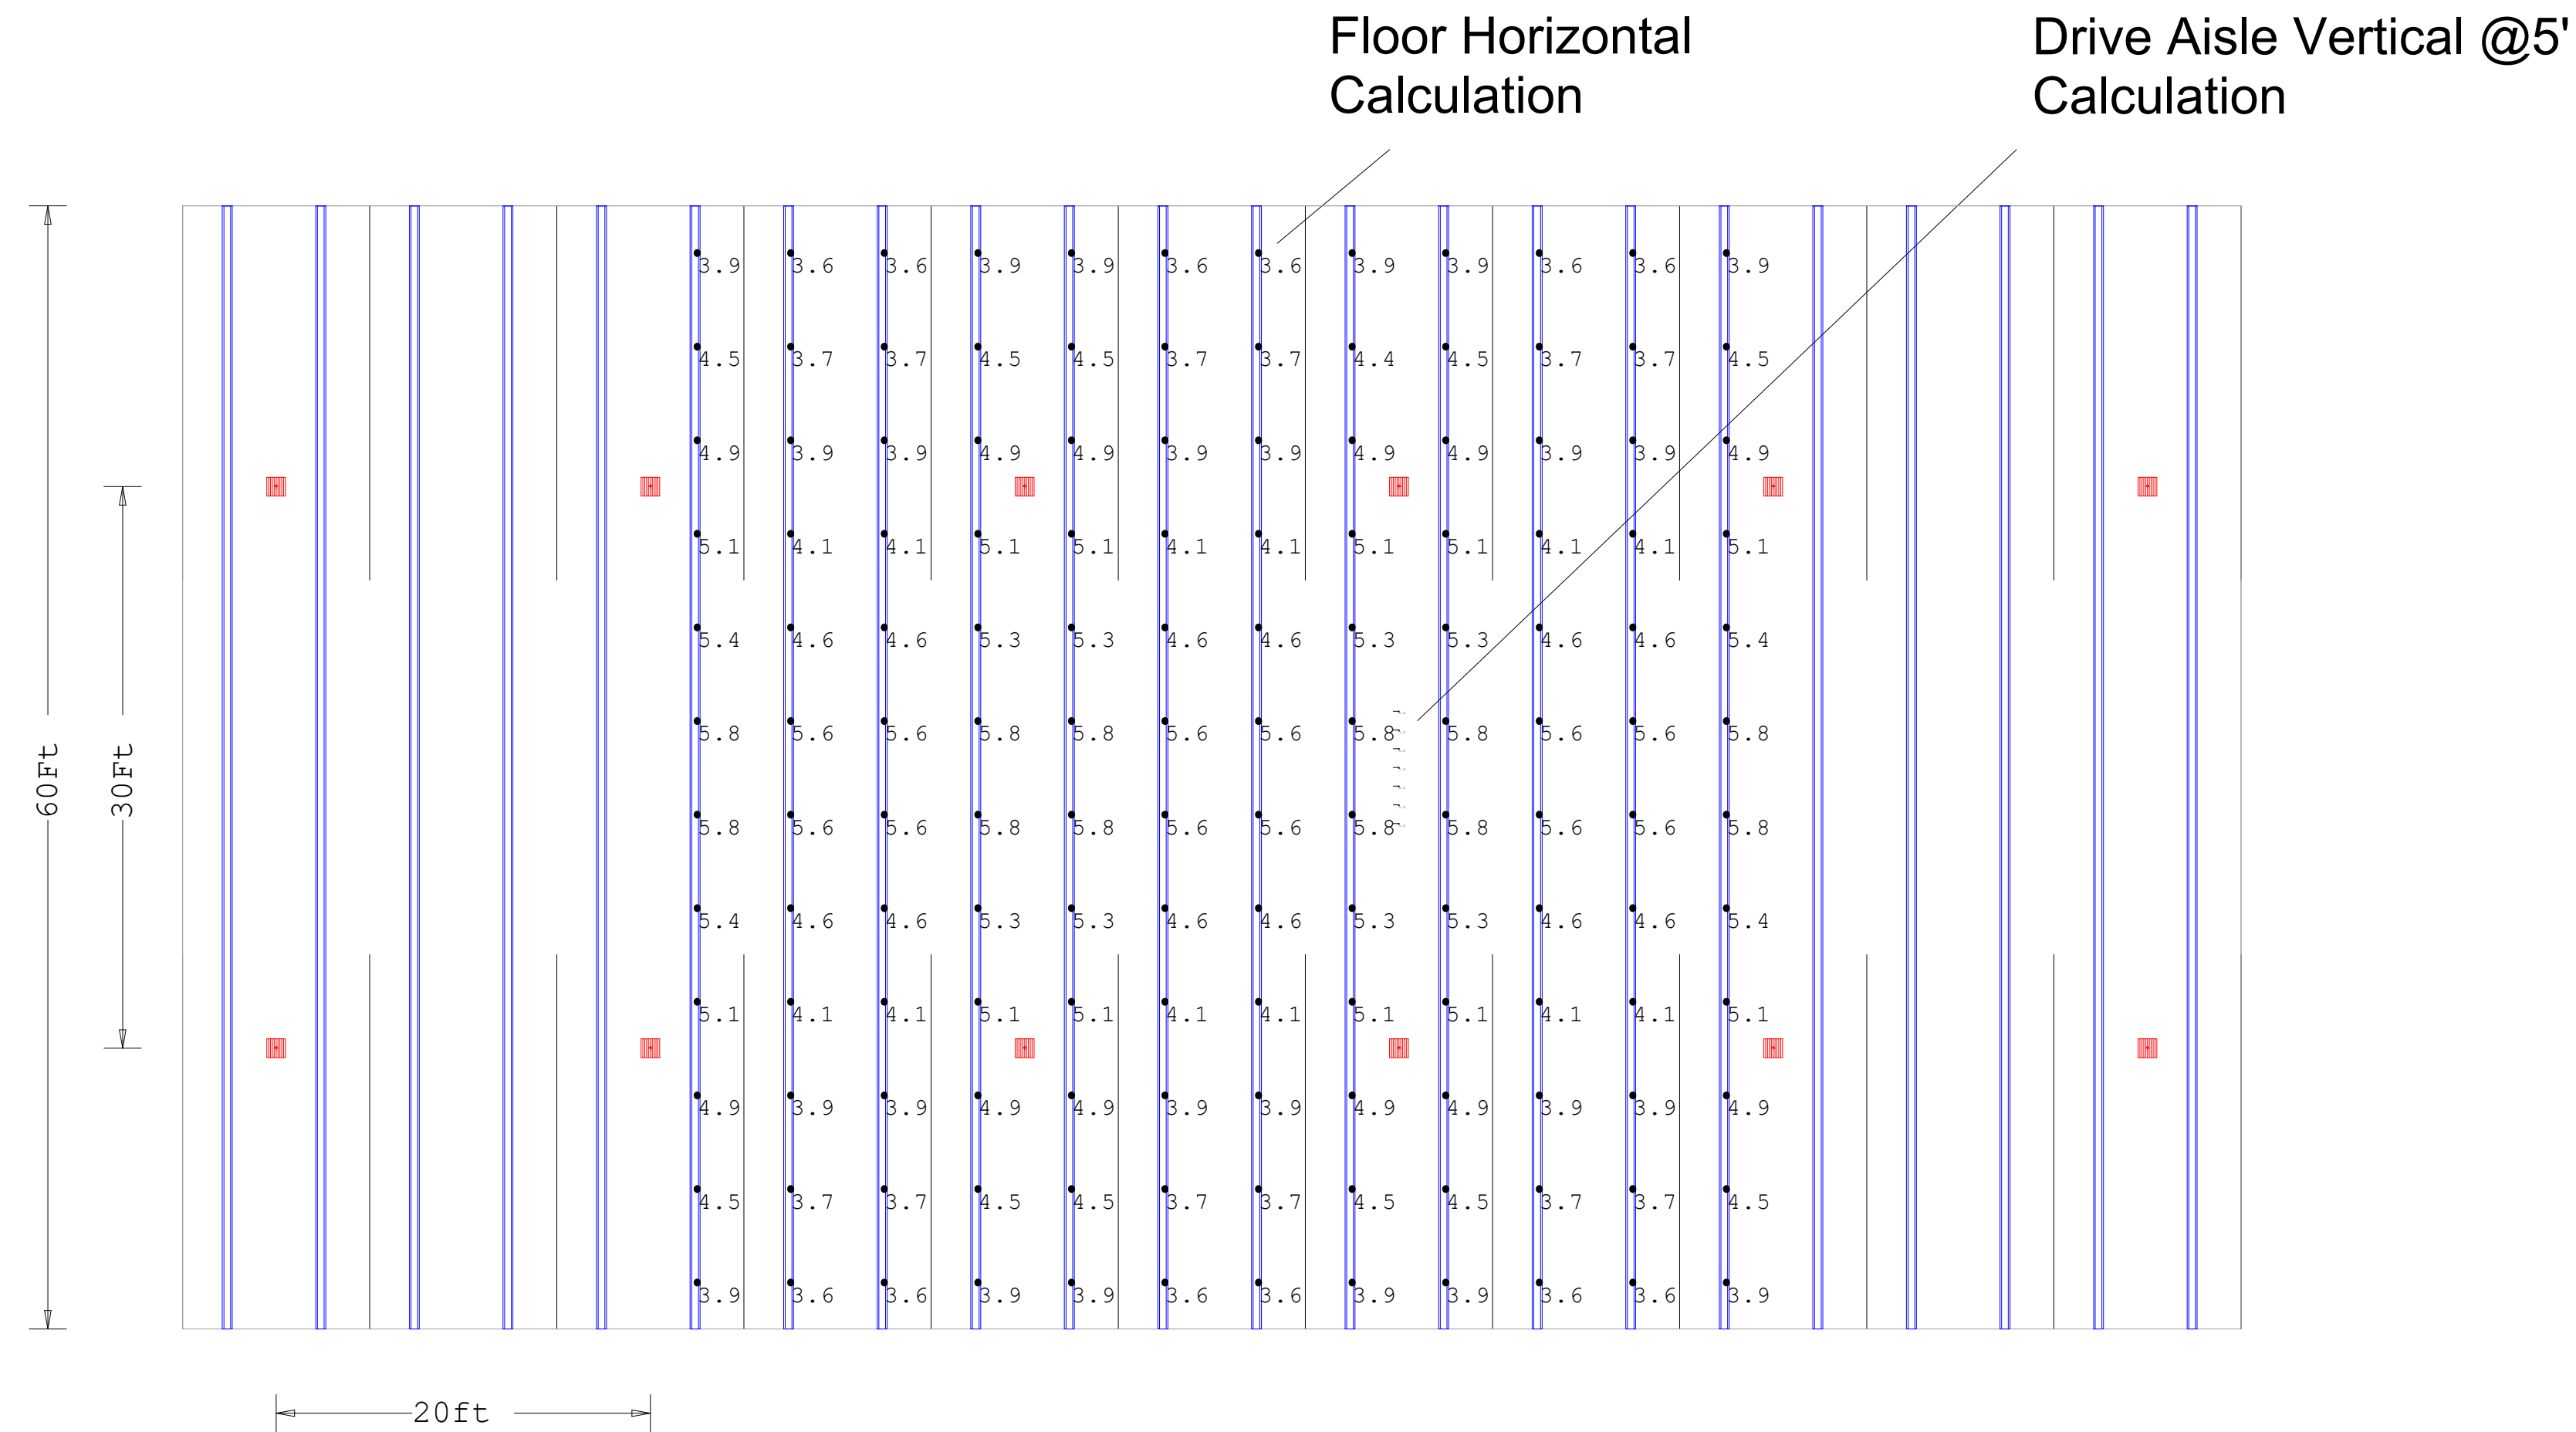

Luminaire Schedule						
Symbol	Description	Lum. Lumens	Lum. Watts	LER	LLD	LLF
☐	CPG-LED-3L-CA-W-40	3387	24.52	138	0.900	0.900

Calculation Summary								
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	
Horizontal at Grade	Illuminance	Fc	4.59	5.8	3.6	1.28	1.61	
Vertical at 5 Feet (Height of Eye)	Illuminance	Fc	1.00	1.0	1.0	1.00	1.00	

Fixtures mounted even with bottom of tees.

Luminaire Location Summary						
LumNo	X	Y	Z	Orient	Tilt	
1	25	15	12	90	0	
2	5	15	12	90	0	
3	105	15	12	90	0	
4	85	15	12	90	0	
5	65	15	12	90	0	
6	45	15	12	90	0	
7	25	45	12	90	0	
8	5	45	12	90	0	
9	105	45	12	90	0	
10	85	45	12	90	0	
11	65	45	12	90	0	
12	45	45	12	90	0	

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine the applicability of the layout to existing or future field conditions.

This lighting plan represents illumination levels calculated from laboratory data taken under controlled conditions in accordance with The Illuminating Engineering Society (IES) approved methods. Actual performance of any manufacturer's luminaires may vary due to changes in electrical voltage, tolerance in lamps/LED's and other variable field conditions. Calculations do not include obstructions such as buildings, curbs, landscaping, or any other architectural elements unless noted. Fixture nomenclature noted does not include mounting hardware or poles. This drawing is for photometric evaluation purposes only and should not be used as a construction document or as a final document for ordering product.

